
Court Size



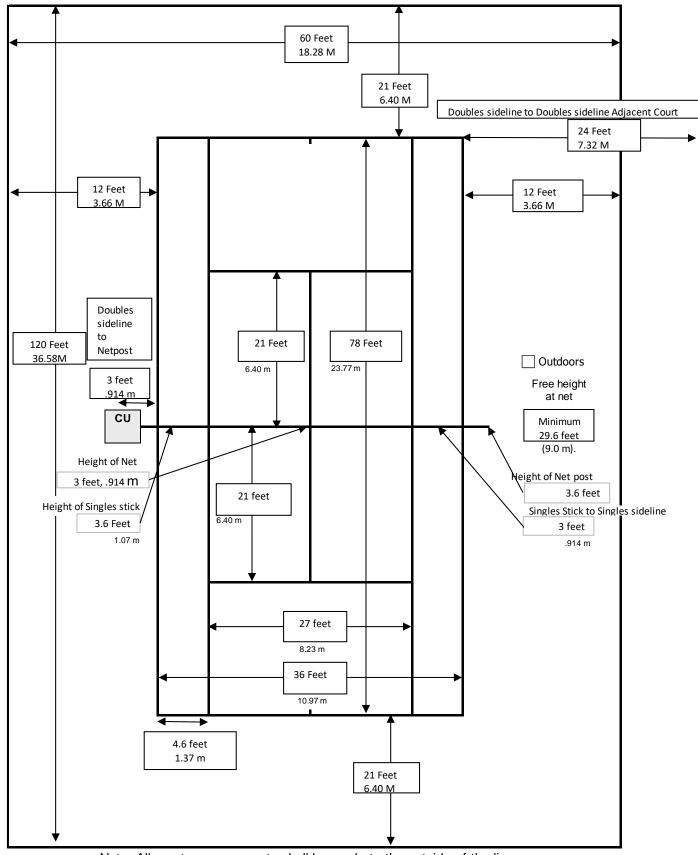

Note: All court measurements shall be made to the outside of the lines.

As a guide for international competitions, the recommended minimum distance between the baselines and the backstops should be 21 feet (6.40 m) and between the sidelines and the sidestops the recommended minimum distance should be 12 feet (3.66 m).

Ceiling Height. Indoor or covered show courts shall have a minimum top height of 10M except as otherwise approved by the ITF.